


CONNECTION LAYOUT FOR ALLOTMENTS > 8m WIDE

NOT TO SCALE

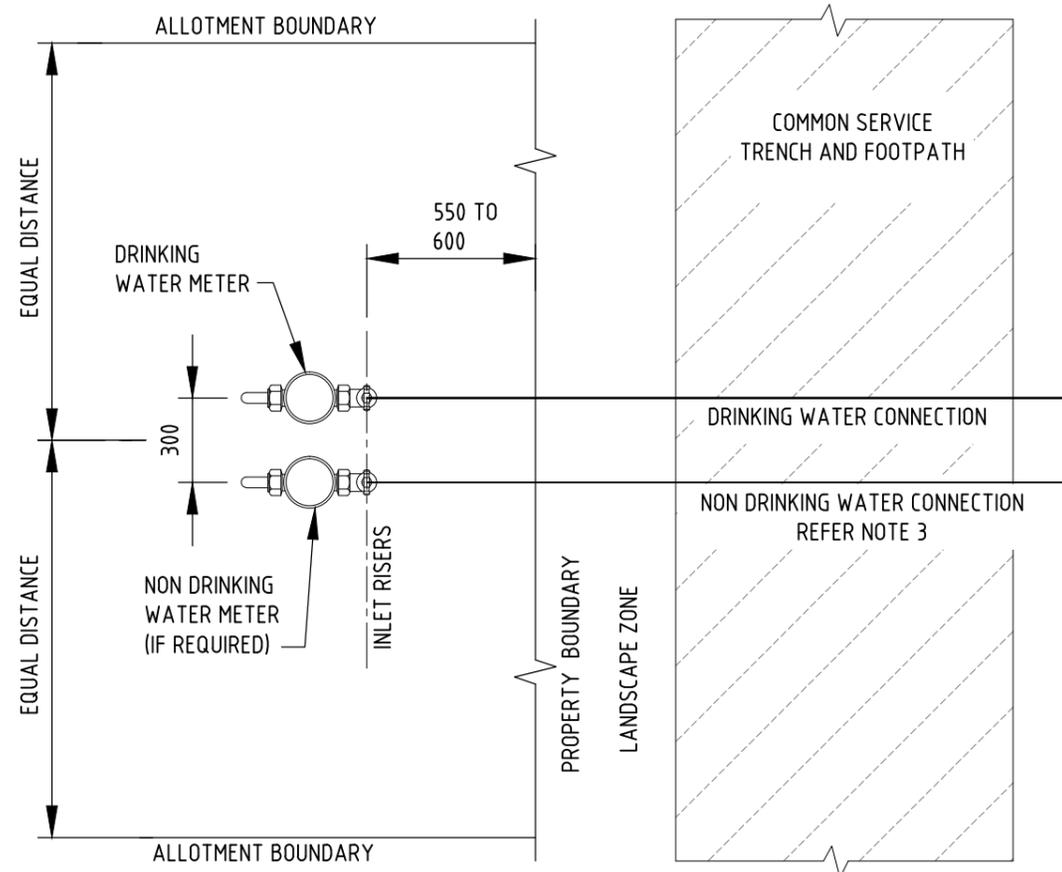

DETAIL A
WATER CONNECTIONS

NOTES:

- REFER 4005-20002-01 & 4005-20002-02 FOR GENERAL NOTES.
- LOCATION OF CONNECTIONS:
WATER CONNECTIONS - DRINKING WATER AND NON DRINKING WATER:
 - STANDARD 'DEFAULT' POSITIONS ARE AS SHOWN.
 - ALTERNATIVE POSITIONS MAY BE SPECIFIED ON THE DESIGN DRAWING. APPROVAL OF THE SA WATER REPRESENTATIVE IS REQUIRED FOR THIS OPTION.
- NON DRINKING WATER PIPE & METER CONNECTION SHALL BE POSITIONED TO THE LEFT OF DRINKING WATER CONNECTION WHEN VIEWED FROM ROADWAY.
- FOR DUAL RETICULATION SYSTEMS (DRINKING WATER & NON DRINKING WATER) THE LOCATIONS AND CLEARANCES SHOWN ON THIS DRAWING SHALL BE ADHERED TO REGARDLESS OF WHETHER THE NON DRINKING WATER SYSTEM SCHEME IS SA WATER OR PRIVATELY OPERATED.
- SEWER CONNECTIONS:
 - FOR STANDARD POSITIONS REFER SEWER CONSTRUCTION MANUAL, SECTION 6.
 - OBSTRUCTIONS OR EXISTING DRAINS MAY REQUIRE AN ALTERNATIVE LOCATION.
 - SINGLE CONNECTIONS SHALL BE USED. SHOULD THE DESIGNER CONSIDER THE USE OF A 'Y' CONNECTION TO SERVE ADJOINING ALLOTMENTS, DETAILS FOR THIS OPTION SHALL BE PROVIDED TO SA WATER REPRESENTATIVE FOR APPROVAL.
 - SINGLE CONNECTIONS SHALL BE ON LOW SIDE OF ALLOTMENT UNLESS IT IS IMPRACTICAL.
- ALL DIMENSIONS IN MILLIMETRES.

REVISION PANEL				
REV	DATE	DRN	DETAILS	APR
1	31/03/16	MS	2016 STANDARDS REVIEW	TG

DESIGN PANEL	
DESIGNED: 03/08/15 RJP	AUTHORISED: 31/03/16 T.GALEK
DRAWN: 25/09/15 MS	SIGNATURE:
REVIEWED: 21/03/16 TG	

This drawing is the property of the SOUTH AUSTRALIAN WATER CORPORATION and shall not be copied or modified in part or in whole without authorization.

SA WATER STANDARD DRAWINGS
SEWER CONSTRUCTION MANUAL
ALLOCATION OF SPACE FOR SERVICES IN LAND DIVISIONS
ALLOTMENT FRONTAGE GREATER THAN 8 m

A3	1
SHT SIZE	REVISION
TOTAL SHEETS:	
SUPERSEDES: D2, D3	
DRAWING NUMBER	
4005-20004-02	
PREFIX	NUMBER SHEET