



ELEVATION

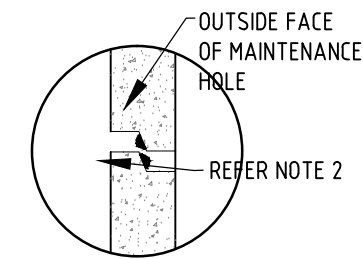


DETAIL 1

TYPICAL JOINT SEALANT

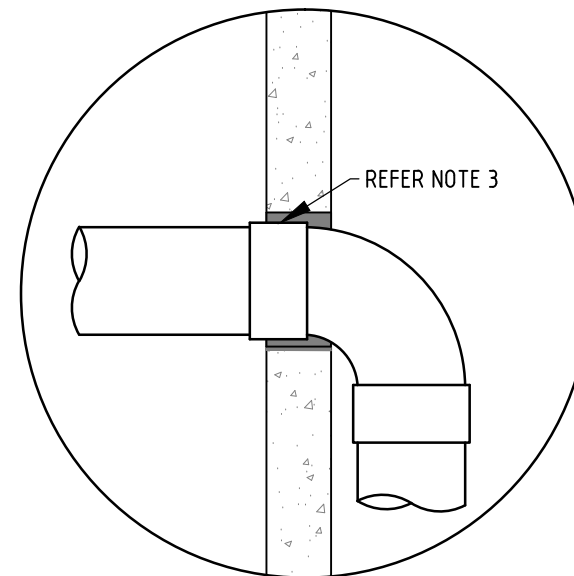

DETAIL 2

TYPICAL WALL REPAIR

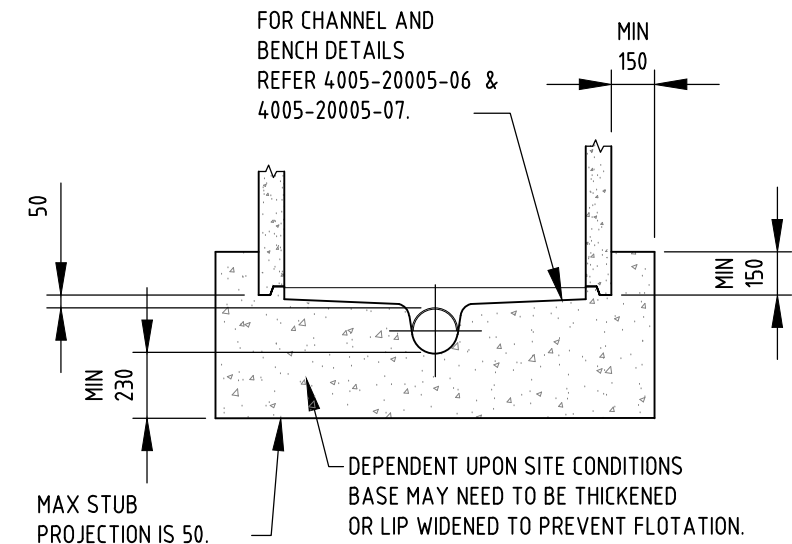

SECTION A

NOTES:

- REFER 4005-20002-01 TO 4005-20002-03 FOR GENERAL NOTES.
- APPLICATION OF PRECAST SECTIONS JOINT SEALANT:
 - INSPECT COMPONENTS TO ENSURE THERE IS NO DAMAGE TO JOINING SURFACES.
 - ATTACH SEALANT STRIP TO EACH SLOPING FACE.
 - TOP INCREMENT LOWERED INTO PLACE.
 - SEALING COMPOUND IS SQUEEZED INTO JOINT.
- WALL REPAIR OF CORED HOLE
 - CORE HOLE IN WALL.
 - CLEAN EDGES OF CUT HOLE AROUND INTERNAL/ EXTERNAL WALLS MIN 50 AROUND HOLE.
 - INSERT PIPE & FILL GAP WITH EPIREZ 633, FERROPRE OR APPROVED EQUIVALENT.
 - FOR THICK IN SITU WALLS, MORTAR IS PERMITTED FOR EXTERNAL PORTION (50%).
 - FOLLOWING MANUFACTURERS DRYING TIME REAPPLY FILLER TO INTERNAL WALL TO SEAL ANY POTENTIAL GAPS.
- CONCRETE POURED IN SITU SHALL BE GRADE N40 IN ACCORDANCE WITH AS 1379.
- ALL DIMENSIONS IN MILLIMETRES.

REVISION PANEL					DESIGN PANEL			SA WATER STANDARD DRAWINGS			A3		1
REV	DATE	DRN	DETAILS	APR	CURRENT REV	AUTHORISED:		SEWER CONSTRUCTION MANUAL			SHT SIZE		REVISION
								TYPICAL PRECAST					
								MAINTENANCE HOLE					
								ASSEMBLY DETAILS					
1	31/03/16	MS	2016 STANDARDS REVIEW	TG									