DO NOT SCALE PAPER PRINT

F.B. Pg.

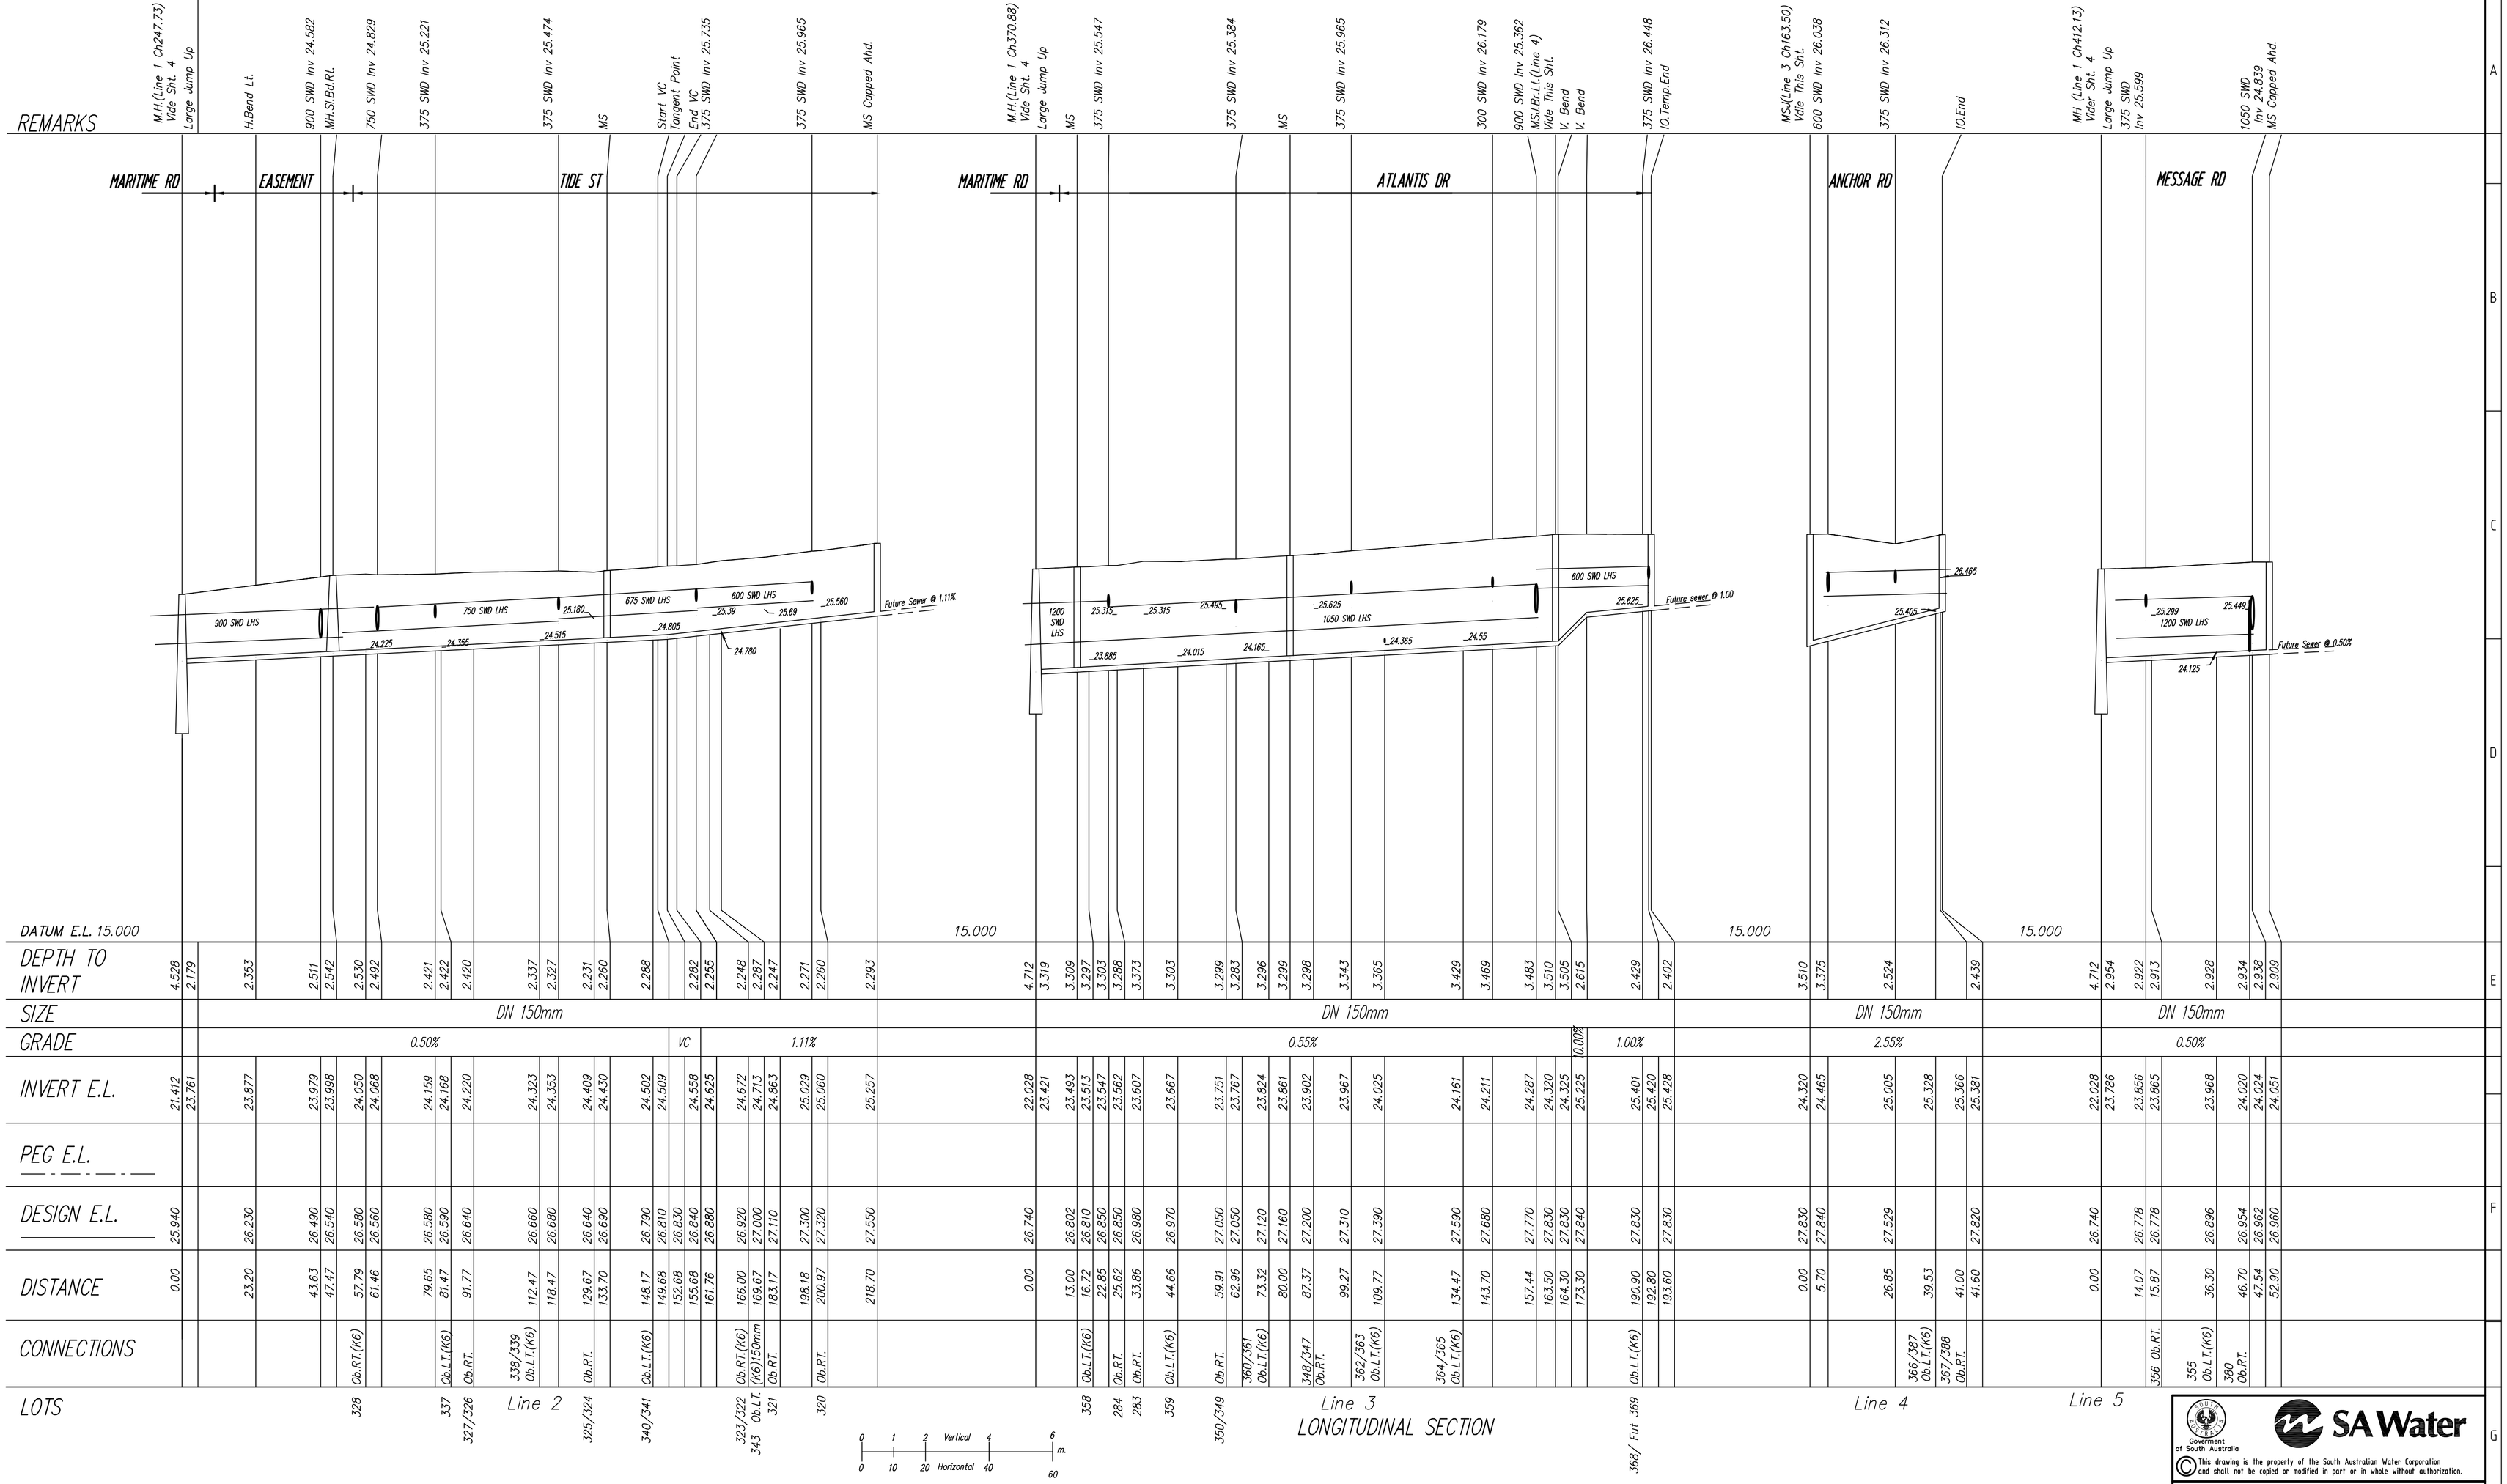

The accuracy of the information shown here is not guaranteed and no responsibility is accepted by the Crown,SA Water or their officers,agents or servants for any loss or damages caused by the reliance upon thisinformation, as a result of an error and or ommision or misdescription hereon, whether caused by negligence or otherwise.Standard SA Water Notes

LEGEND
WASTE WATER

- Proposed Sewer, Proposed Maintenance Hole
- Maintance Shaft
- Maintenance Shaft Terminal
- Sewer Proposed in Adj. Schemes
- Future Sewer
- Existing Sewer, Connection and Maintenance Hole
- Pumping Main — PM
- Inspection Opening
- Inspection Point
- Contract Boundary
- NS. EL. at I.P. 24.55; Final EL. at I.P. 23.63; Inv. EL. of I.P. 22.23
- Spot level × 19.33 (19.33)
- Design level
- Line No. 1
- Sheet No. 2
- Area not served
- Area of fill
- Maintenance Hole
- Maintenance Shaft
- Maintenance Hole Jump Up
- I.O.
- Proposed Sewer
- Exist Sewer — Exist Sewer 150Ø at 12.00%
- Future Sewer — Future Sewer 150Ø at 12.00%
- Natural Surface
- Design Surface

Sheet No	Length	Prog. Total	Pipe Discription
5	506.80	506.80	DN 150

ACTUAL

Easement to be taken on final plan of division

Easement Or Land To Be Acquired	Reference For Acquisition	Special Conditions	Signature & Date

Amendment -

Rev	Date	Drn.	Description.

LEGEND
H.Bend = Horizontal Vario-bend
V.Bend = Vertical Vario-bend
MSE = Maintenance Shaft Elbow
MSJ = Maintenance Shaft Junction
MST = Maintenance Shaft Terminal
MS = Maintenance Shaft
MH = Maintenance Hole
IO = Inspection Opening

FREE ASSET

Standard SA Water Notes:
- All connections to be Ø100mm. UNO
- All easements to be 3m. wide UNO
- Sewer to be located centrally in easement UNO
- Connection Locations refer SCM page K1
- All connections to be laid similar to K 3 & K4 UNO
- All lines are available both sides UNO

AUTHORIZATION
Signature : Date : / /
Name :
CHARTERED ENGINEER

CONTRACTORS WORK SPACE

LOGOS NOT PERMITTED

Government of South Australia

SA Water

© This drawing is the property of the South Australian Water Corporation and shall not be copied or modified in part or in whole without authorization.

CONSTRUCTION DRAWING RECEIVED
Date :
CPC Issued Date : CONTRACT No. : 123/69
FOR FURTHER INFORMATION VIDE
DRAINAGE AREA : Adelaide
COUNCIL : Adelaide
D.P. : L.O. : 120/d345/69
CADASTRE REFERENCE : 6612-34-h3 G.G.Date :

SOMEWHERE SOUTH
STAGE Z
SEWER IN MARITIME RD, TIDE ST, ATLANTIS AV, ANCHOR RD, MESSAGE RD & EASEMENT
LONGITUDINAL SECTIONS

SHEET SIZE	SA WATER DOCKET NUMBER	REVISION
A1	90123/09	

SHEET 5 OF 5

DRAWING NUMBER 2069- 3001 -05 (YEAR / NUMBER / SHEET)

BAR CODE